



Controller power supply via junction box
7.03.688 Cable junct. Dunker 8DIN

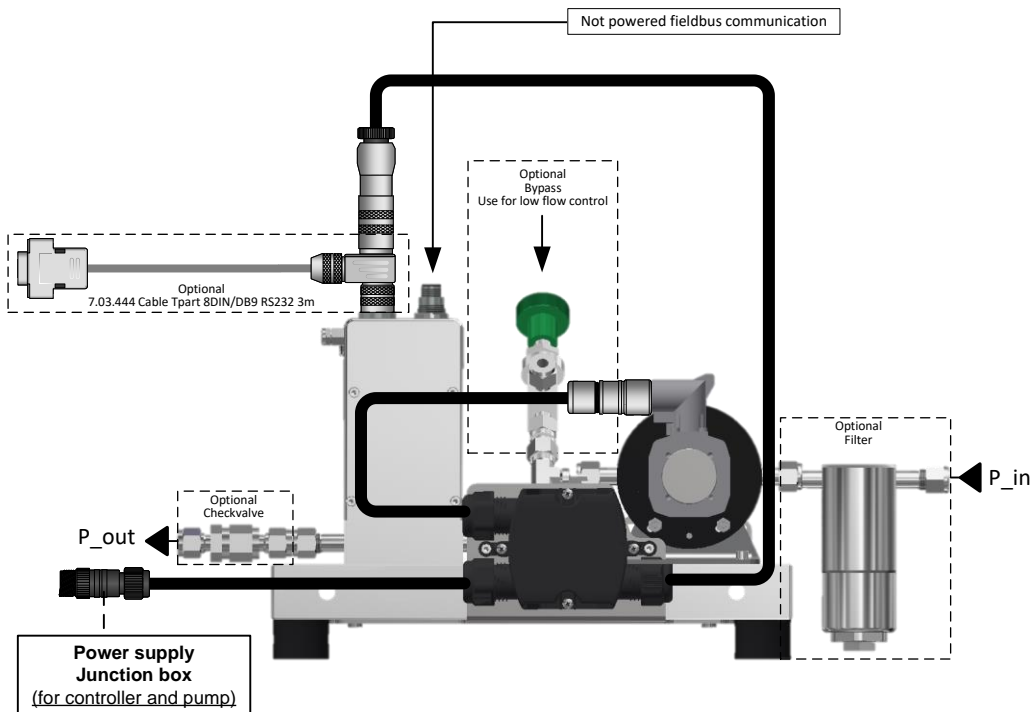


Controller power supply via powered fieldbus
7.03.689 Cable junct. Dunker M8 6p male

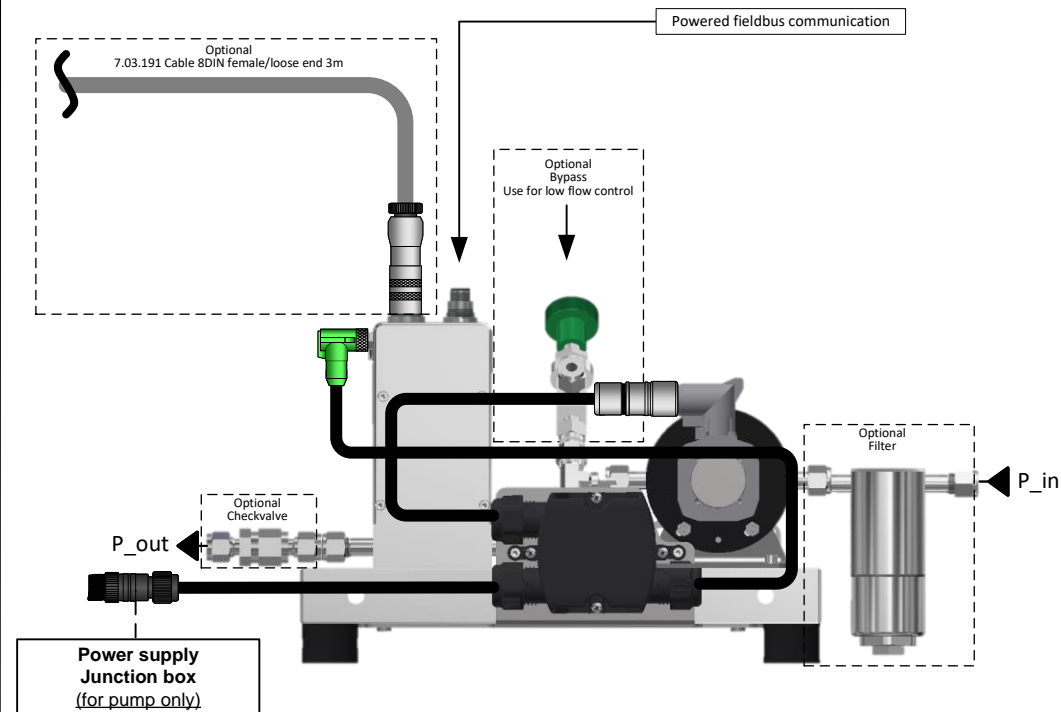

When connecting the system to other devices, be sure that the integrity of the shielding is not affected. Do not use unshielded wire terminals. Keep unconnected wire ends isolated.

Power supply Junction box

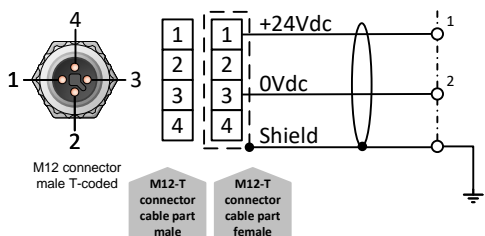

Note: Pump (BG45) needs:24 Vdc (min. 4A) Power supply

Hook-up diagrams

Fieldbus hook-up for mini CORI-FLOW M13 can be downloaded at:
<https://www.bronkhorst.com/int/products/liquid-flow/mini-cori-flow/m13/>
 Fieldbus hook-up for mini CORI-FLOW M14 can be downloaded at:
<https://www.bronkhorst.com/int/products/liquid-flow/mini-cori-flow/m14/>